

BOIL ORDER LIFTED

Attention Residents, The City of Troy Water Department has LIFTED a boil order issued on (05/13/21) for Low or no pressure due to a water main break.


Water samples have been confirmed to be free of coliform bacteria by a certified laboratory. You may return to normal use of your water service.

Please call the water department at 667-9924 ext. 2 during normal business hours. Please call 667-6731 after hours if you have any questions or need further information.

Thank you for your patience,

Robert Hancock

Robert Hancock, Public Works Director

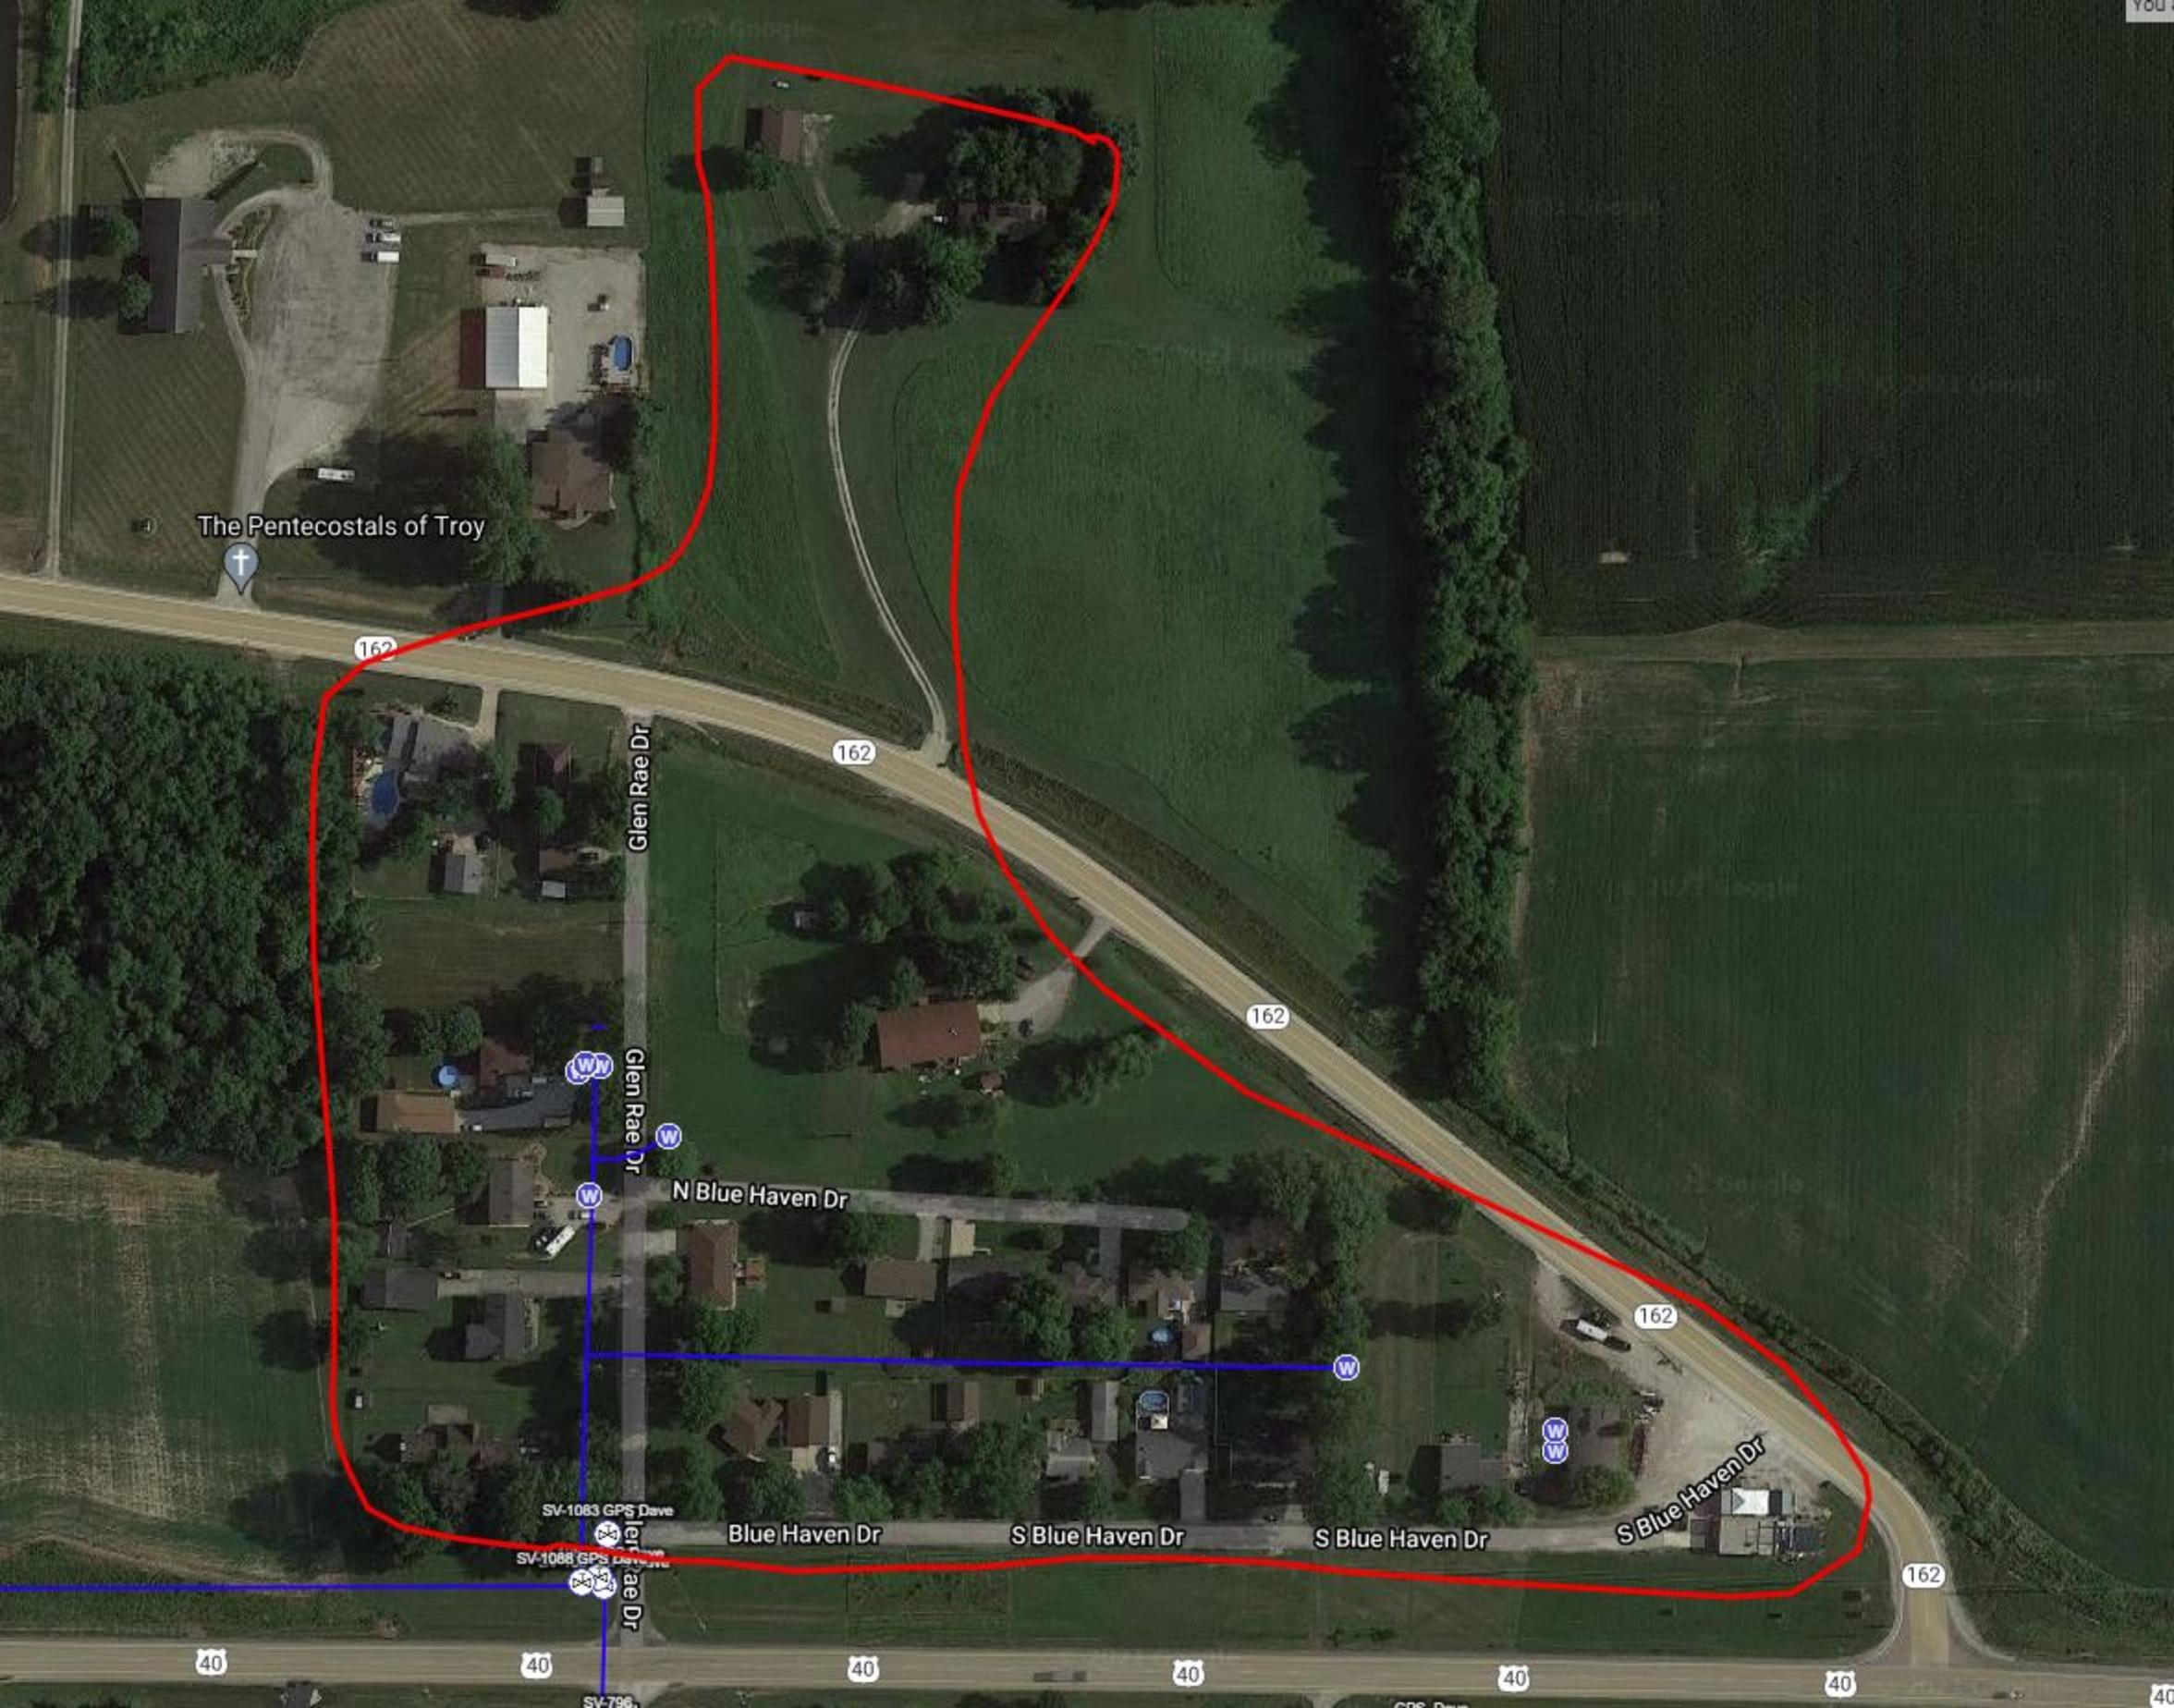

The Pentecostals of Troy

162

162

162

162

162

40

40

40

40

40

40

40

Glen Rae Dr

Glen Rae Dr

N Blue Haven Dr

Blue Haven Dr

S Blue Haven Dr

S Blue Haven Dr

S Blue Haven Dr

SV-1083 GPS Dave

SV-1088 GPS

SV-796

WN

W

W

W

WN

WN